

Comparative Study of Economic Load Dispatch Using Lambda Iteration Method & Genetic Algorithm

Bhushan Makwane¹, Mrs.Santoshi. R.Gawande²
Dept. Electrical Engineering, KDKCOE, Nagpur^{1,2}

Abstract: This paper present the application of Genetic Algorithm (GA) to Economic Load Dispatch problem of the power system. Economic Load Dispatch is one of the major optimization problems dealing with the modern power systems.ELD determines the electrical power to be generated by the committed generating units in a power system so that the total generation cost of the system is minimized, while satisfactory the load demand. The objective is to minimize the total generation fuel cost and maintain the power flow within safety limits. The introduced algorithm has been demonstrated for the given test systems considering the transmission line losses.

Keywords: Economic load dispatch(ELD),Lambda Iteration method,Genetic Algorithm.

I. INTRODUCTION

The sizes of electric power system are increasing rapidly to meet the total demand but the rate of increase of generation is less than the rate of increase of power demand hence it is necessary to operate power system in economic manner. This can be done by ELD techniques. The most common task in power system is to determine and provide an economic condition for generating units without violation of any system constraints, which is known as Economic Load Dispatch (ELD). The parameters must be taken into account for any ELD problem are load demand, transmission power losses and generation cost coefficients. The total operating cost of a power plant depends upon the fuel cost, cost of labour, supplies and maintenance. Generally the costs such as cost of labour, supplies and maintenance being difficult to determine and approximate, are assumed to change as a fixed percentage of the fuel cost. Thus cost function of power plant which is mainly dependent on fuel cost is given as a function of generation. Traditionally the cost function in ELD problem has been approximated as a quadratic function [1]. The generation cost depends upon the system constraint for a particular load demand it means that the generation cost is not fixed for a particular load demand but depends upon the operating constraint of the sources.

There are many traditional optimization methods to solve ELD problem. These traditional methods are lambda iteration, gradient method, base point, participation factor method, Newton's method, Linear programming, and quadratic programming. ELD is major topic and many research works have been done in this field. In ELD problem has been solved by using GA. In PSO technique has been used to solve ELD problem.

II.PROBLEM FORMULATION

The primary goal of ELD problem is to minimize the total fuel cost while fulfilling the operational constraints of the power system. In ELD problem allocation of optimal

power generation among the different generating units at minimum possible cost is done in such a way so as to meet demand constraint and generating constraint. The formulation of ELD problem can be done as follows-

1. Objective function

The ELD problem can be formulated by single quadratic function which is given by following equation:-

$$F(P_{gi}) = \sum_{i=0}^{Ng} F_i(P_{gi}) \quad (1)$$

Where,

$F(P_{gi})$ =Total fuel cost

$F_i(P_{gi})$ =Fuel cost of ith generator

N_g = Number of generator

The fuel cost of ith generator can be expressed as,

$$F_i(P_{gi}) = a_i P_i^2 + b_i P_i + c_i \quad (2)$$

Where,

a_i, b_i, c_i = Fuel cost coefficients of ith generator.

2. System Constraint

There are two types of constraints in ELD problem:

2.1 Equality Constraint (Power balance constraint)

The cost function is not affected by reactive power but it is affected by real power. According to this constraint summation of real power of all the generating unit must be equal to the total real power demand on the system plus power transmission loss. This constraint is also known as power balance constraint.

$$\sum_{i=0}^{Ng} P_{gi} = P_d + P_L \quad (3)$$

Where,

P_{gi} = Real power generation of ith generator

P_d = Total real power demand

P_L = Power transmission loss

2.2 Inequality Constraint

Inequality constraints for the generating unit can be given as follows:

$$P_{gi}^{\min} < P_{gi} < P_{gi}^{\max} \quad (4)$$

Where,

P_{gi}^{\min} = minimum limit of power generation of ith generator

P_{gi}^{\max} = maximum limit of power generation of ith generator

Transmission loss can be expressed as a function of generator power through B-coefficients. The simplest form of loss equation using B-coefficients is given by

$$PL = \sum_{i=1}^{NG} \sum_{j=1}^{NG} P_{gi} B_{ij} P_{gj} \text{ MW} \quad (5)$$

Where,

P_{gi}, P_{gj} = Real power generation at the ith and jth buses, respectively

B_{ij} = Loss coefficients

III. LAMBDA ITERATION METHOD

One of the most popular traditional technique to solve ELD problem for minimizing the cost of generating unit is lambda iteration method. Although in lambda iteration technique computational procedure is complex but it converges very fast for this type of optimization problem.


The detailed algorithm of lambda iteration method for ELD problem is given below:

1. Read given data, for example cost coefficients (a_i, b_i, c_i), B-coefficients, power limits and power demand.
2. Assume the starting value of λ and $\Delta\lambda$
3. Calculate generated power P_{gi} from each unit.
4. Check generation limit for each unit.

If $P_{gi} > P_{gi}^{\max}$, set $P_{gi} = P_{gi}^{\max}$

If $P_{gi} < P_{gi}^{\min}$, set $P_{gi} = P_{gi}^{\min}$

5. Calculate total generated power.
6. Calculate mismatch in power which is given by following equation
7. If $\Delta P < \epsilon$, then stop calculation and calculate the generation cost. Otherwise go next step.
8. If $\Delta P > 0$, then $\lambda = \lambda + \Delta\lambda$
9. Repeat the procedure from step 3.

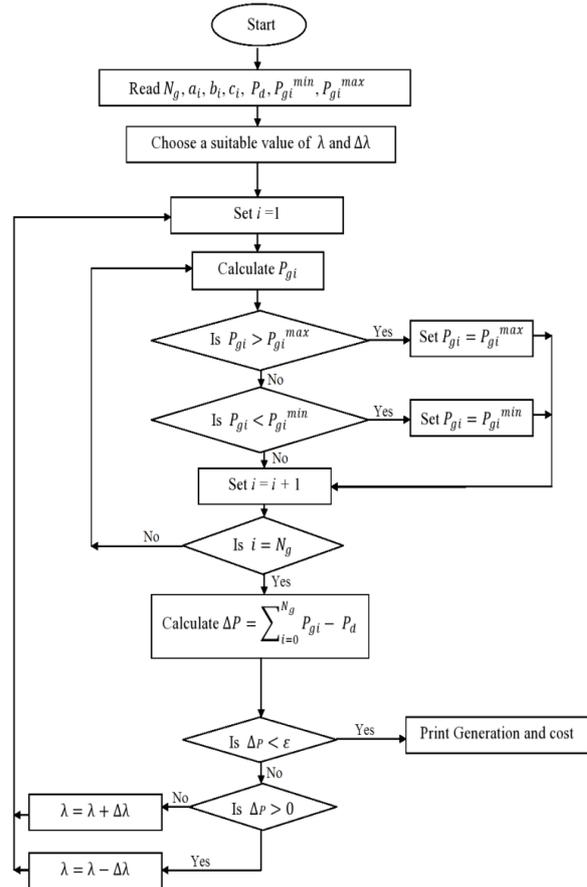


IV. GENETIC ALGORITHM

Traditional optimization methods such as those described are by far the most common optimization tool used in the industry. However, these techniques can encounter some difficulties such as getting trapped in local minima, increasing computational complexity and being not applicable to certain objective functions. This calls for developing a new class of solution methods that can overcome these limitations. Heuristic optimization is fast nascent tools that can overcome most of the shortcomings found in derivative based techniques.

In 1975 Holland first used the concepts of real world to solve the search and optimization problem and invented GA as a power tool in its “Adaptation in natural and artificial systems”. Main attraction of GA is its simple concept that is both easy to implement and computationally efficient. GA has a flexible and well balanced mechanism to enhance exploration and exploitation abilities. GA can be viewed as a general-purpose search method, an optimization method, or a learning mechanism, based loosely on Darwinian principles of biological evolution, reproduction and “the survival of the fittest”.

GA maintains a set of candidate solutions called population and repeatedly modifies them. At each step, the GA selects individuals from the current population to be parents and uses them to produce the children for the next generation.

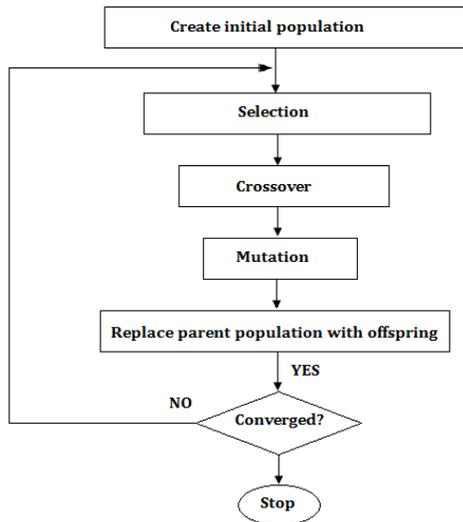

A. ECONOMIC LOAD DISPATCH USING GA

Step 1. Initialization

Initialize population size, maximum generation, stall time limit and read the cost coefficients and B coefficients.

Step 2. Formation of population

The initial power search for each generator can be obtained by

$$P_{ij} = P_{imin} + \{(P_{imax} - P_{imin}) / (2i-1)\} * b_{ij}$$

Where, i = number of generator

j = number of generation

Step 3. Evaluate the fitness function.

The incremental transmission losses denoted as ‘B’ is calculated as per formula the given below and determines the best fitness and mean fitness values.

Step 4. Apply genetic operators

Parent individuals are selected using ‘Roulette Wheel’ selection procedure and single point crossover is used and finally mutation operator is used for regaining the lost characteristics during the process.

Step 5. Repeat the step 3 and step 4 until the process has been converged or it satisfies the stopping criteria.

V. NUMERICAL RESULT

The result of ELD after the implementation of proposed methods Lambda iteration method and Genetic Algorithm method’s are discussed. The programs are implemented in MATLAB 7.6.0. The performance is evaluated with considering losses for 6 generator test system. For the calculation of transmission line loss we have consider only the diagonal elements of loss coefficient matrix. The coefficients of fuel cost and maximum and minimum power limits are given below:-

Table 1:- Fuel cost coefficients & generator’s minimum and maximum limits

a_i	b_i	c_i	P_{min}	P_{max}
0.005	2	100	10	85
0.010	2	200	10	80
0.020	2	300	10	70
0.003	1.95	80	50	250
0.015	1.45	100	5	150
0.010	0.95	120	15	100

Table 2:-Loss coefficient for 6 generator system (*10⁴MW⁻¹)

0.14	0.17	0.15	0.19	0.26	0.22
0.17	0.6	0.13	0.16	0.15	0.2
0.15	0.13	0.65	0.17	0.24	0.19
0.19	0.16	0.17	0.71	0.3	0.25
0.26	0.15	0.24	0.3	0.69	0.32
0.22	0.2	0.19	0.25	0.32	0.85

Result:-Optimal ELD for power generation using Lambda Iteration Method and Genetic Algorithm for 6 generator test system.

N generator	Lambda Iteration Method	Genetic algorithm
P_{g1}	84.046	81.126
P_{g2}	44.023	43.978
P_{g3}	22.011	20.103
P_{g4}	159.077	158.347
P_{g5}	47.682	49.477
P_{g6}	96.523	100
Fuel cost(Rs/hr)	131824.8	131797.6

VI. CONCLUSION

In this paper, the two proposed methods are compared for solving an ELD problem. The test results show that the GA thus gives us well satisfactory results. This shows that it is much faster and more effective than the traditional techniques. Another advantage of the GA approach is the ease with which it can handle arbitrary kinds of constraints and objectives.

REFERENCES

- [1] Rahul Dogra, Nikita Gupta, Harsha Saroa, “Economic Load Dispatch Problem and Matlab Programming of Different Methods”, ICARI-2014 ISBN 978-93-5156-328-0
- [2] Bishnu Sahu, Avipsa Lall, Soumya Das, T. Manoj Patra, “Economic Load Dispatch in Power System using Genetic Algorithm”, International Journal of Computer Application (0975-8887), vol67-No.7, April 2013.
- [3] Arunpreet Kaur, Harinder Pal Singh, Abhishek Bhardwaj, “Analysis of Economic Load Dispatch Using Genetic Algorithm”, IJAIEEM, vol3, issue 3, March 2014.
- [4] Gajendra Sahu, Kuldeep Swarnkar, “Economic Load Dispatch by Genetic Algorithm in Power System”, International Journal of Science, Engineering and Technology Research (IJSETR), vol3, issue8, Aug 2014.
- [5] Lahouari Abdelhanken Koridak, Mustafa Rahli, Mimous Younes, “Hybrid Optimization of the Emission and Economic Dispatch by Genetic Algorithm”, Leonardo Journal of science, pp.193-203, January-June 2008.
- [6] S. Roshni, C.R. Pradhan, Biswajit Mohapatra, “Comparative Study of Economic Load Dispatch Problem Using Classical Methods & Artificial Intelligence Method”, ISO 3297:2007, vol.4, issue3, March 2015.
- [7] M. Anuj Gargey, Sai Praneeth Pabba, “Economic Load Dispatch Using Genetic Algorithm & Pattern search Methods”, International Journal of Advance Research in Electrical, Electronics and Instrumentation Engineering, vol.2, issue4, April 2013.
- [8] Haddi Saddat, “Power System Analysis”, Tata McGrawhill.